

Figure 1

CSF FLOW SCHEMATIC

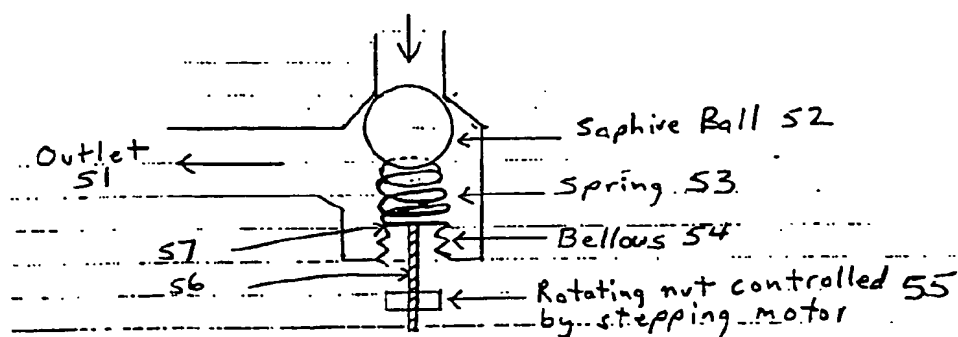


Figure 2. Variable Spring-Length Check Valve.

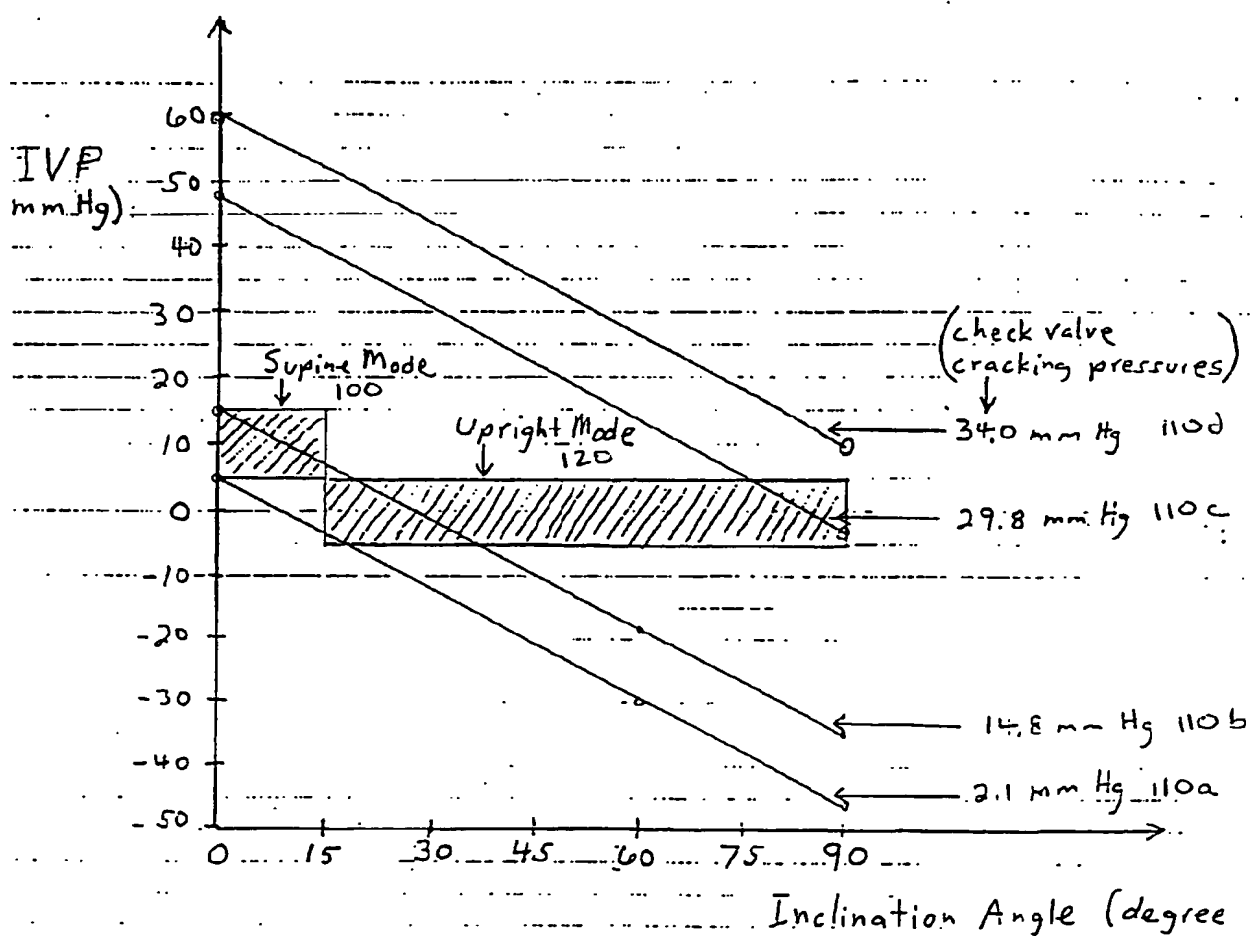


Figure 3. Variable Check Valve Performance

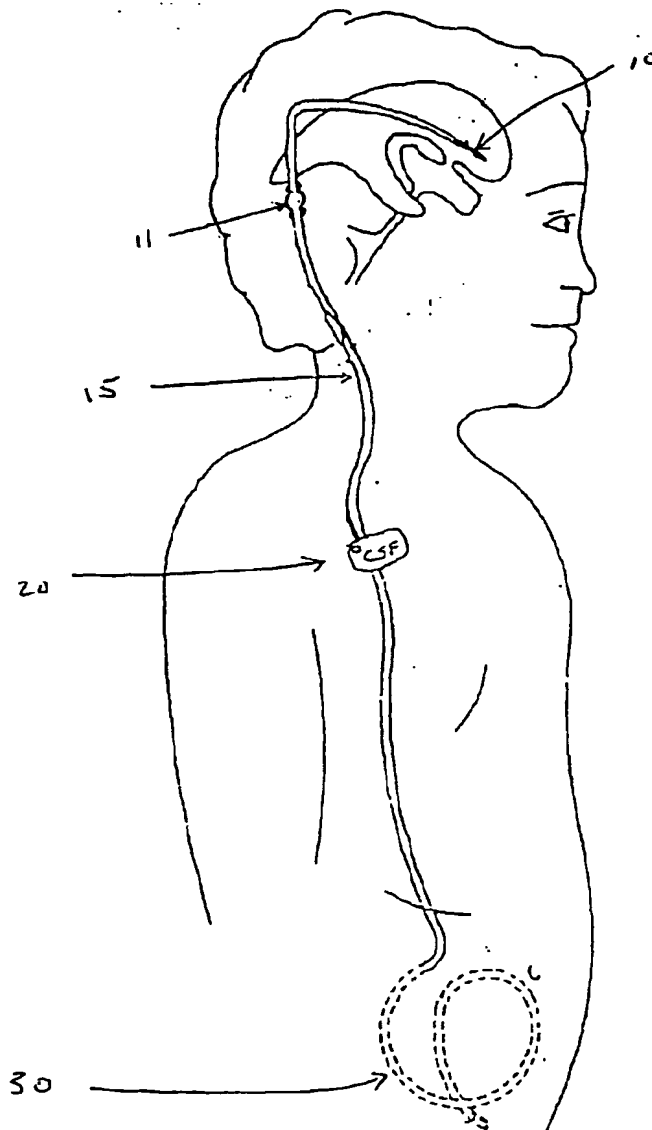


Figure 4. PREFERRED IMPLANTATION SITE


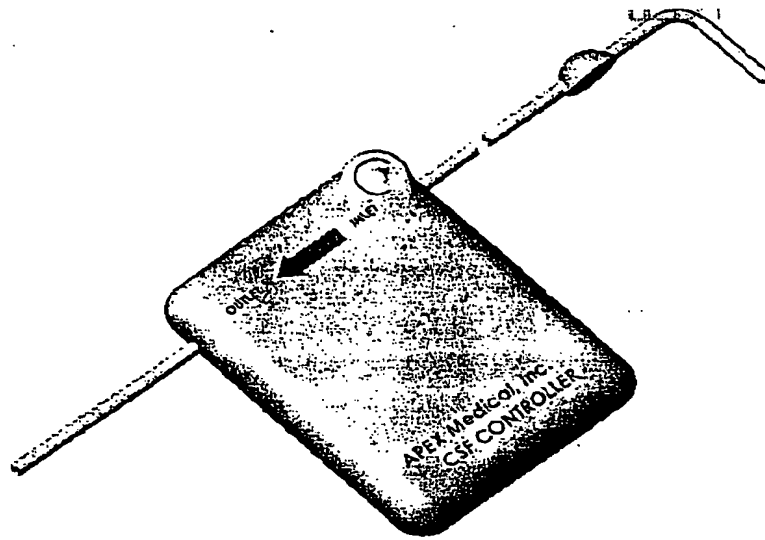


Figure 5

CSF Physiologic Controller

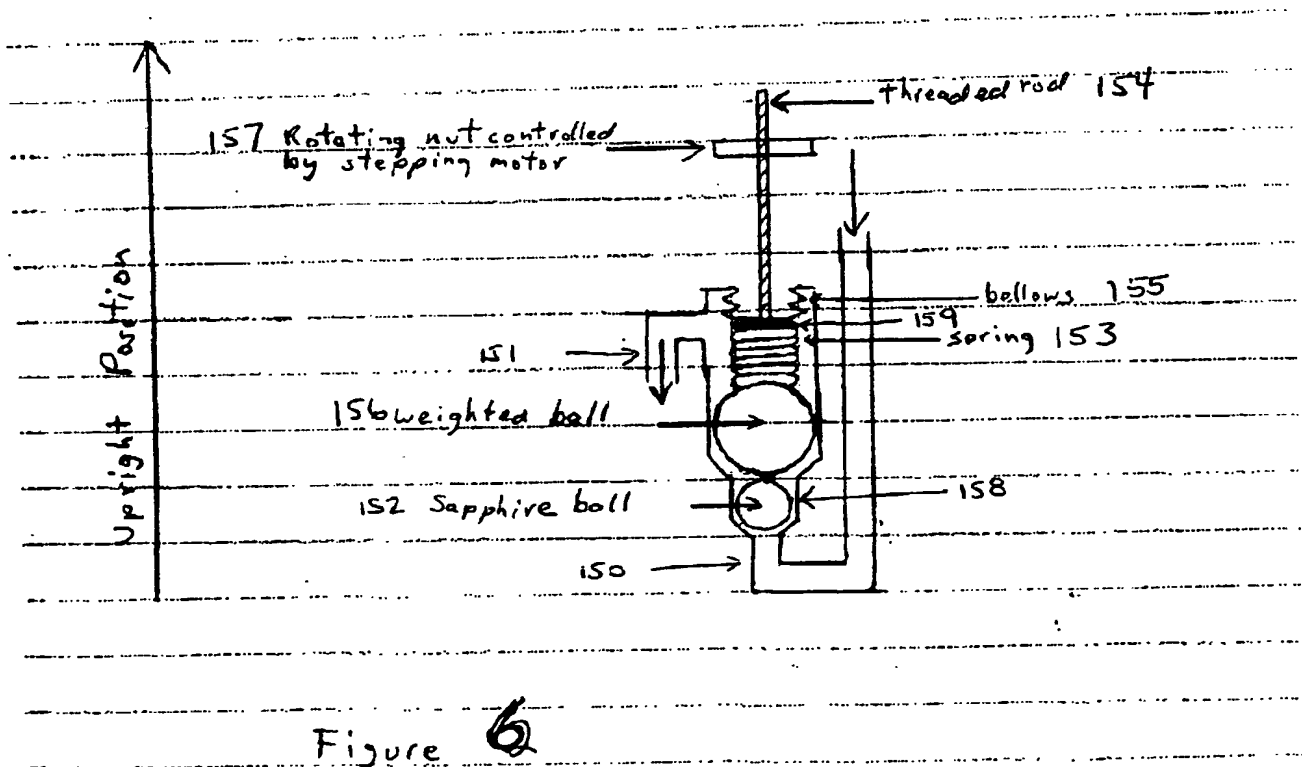

BEST AVAILABLE COPY